



Montageanleitung / Mounting Instruction

Kunststoffprogramm-Produktprogramm / Plastic-products



ESKV PLUS **

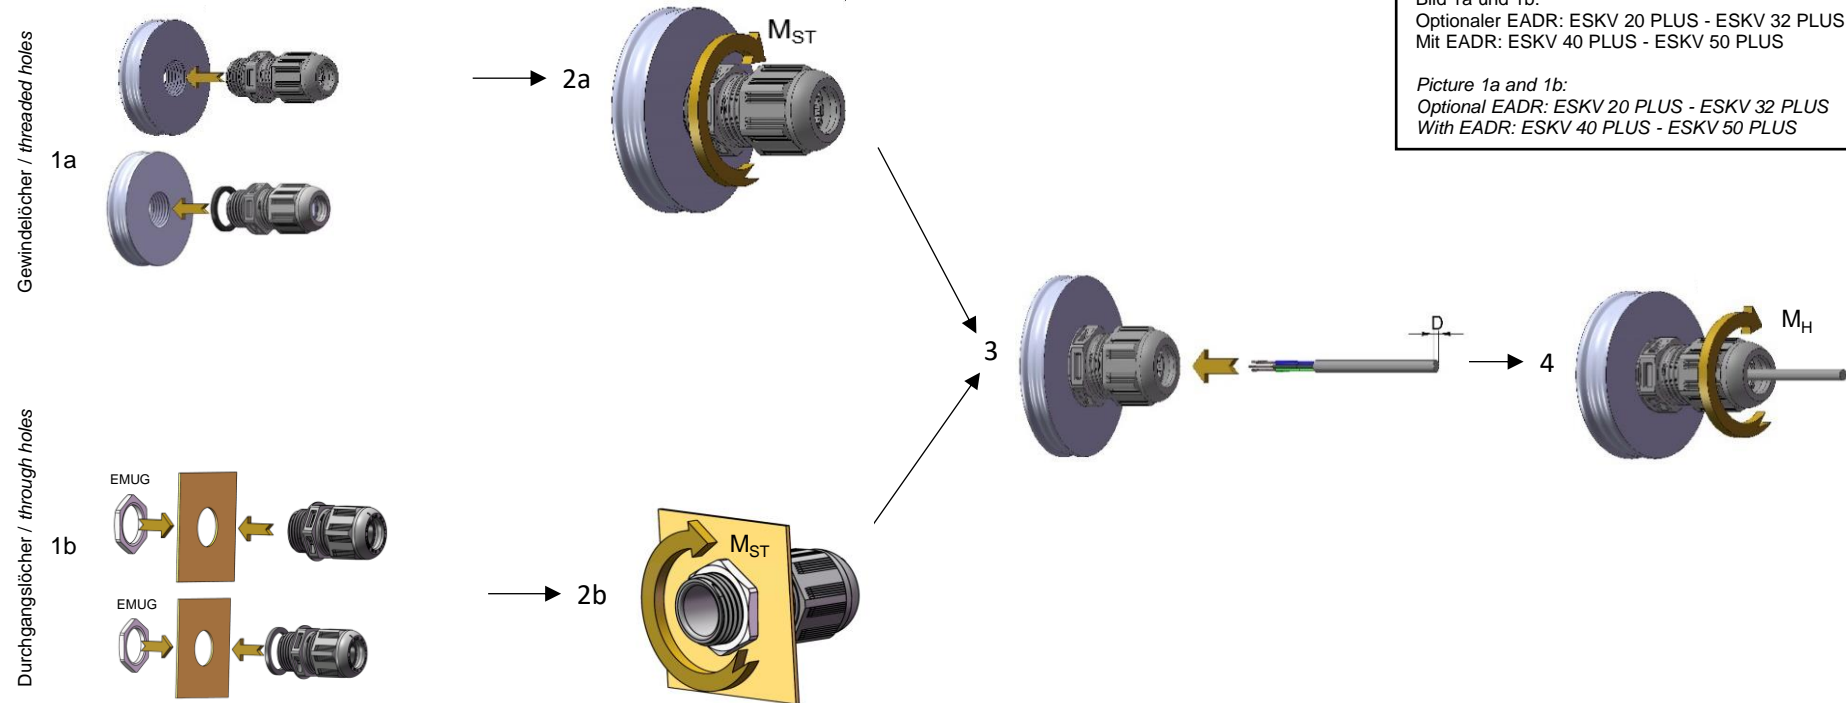


Bild 1a und 1b:
 Optionaler EADR: ESKV 20 PLUS - ESKV 32 PLUS
 Mit EADR: ESKV 40 PLUS - ESKV 50 PLUS

Picture 1a and 1b:
 Optional EADR: ESKV 20 PLUS - ESKV 32 PLUS
 With EADR: ESKV 40 PLUS - ESKV 50 PLUS

Kabelverschraubung / cable gland	M _{ST} ohne/without EADR [Nm] ¹⁾	M _{ST} mit/with EADR [Nm] ¹⁾	M _H [Nm] ¹⁾	D [mm]
ESKV 20 PLUS [+ EMUG 20]	4,0	3,0	3,0	7,5 - 14
ESKV 25 PLUS [+ EMUG 25]	10,0	4,0	4,0	13 - 17,5
ESKV 32 PLUS [+ EMUG 32]	15,0	4,0	4,0	19 - 14
ESKV 40 PLUS [+ EMUG 40]	-	10,0	4,0	26 - 32
ESKV 50 PLUS [+ EMUG 50]	-	15,0	15,0	32 - 39



WISKA Hoppmann GmbH • Kisdorfer Weg 28 • 24568 Kaltenkirchen • Germany

1) Die angegebenen Drehmomente wurden unter Laborbedingungen und mit Prüfdornen nach EN 62444 ermittelt. Damit handelt es sich bei den Drehmomenten um Richtwerte. Die Drehmomente sollten unter Normalklima für Stützen und Gegenmüttern eingehalten werden. Je nach verwendeten Kabel ist beim Anziehen der Hutmüttern darauf zu achten, dass die Drehmomente nicht überschritten werden um Kabelbeschädigungen zu vermeiden.

The specified torques were determined under laboratory conditions and with test mandrels according to EN 62444. The torques are therefore guide values. The torques should be observed under normal climatic conditions for fittings and locknuts. Depending on the cable used, care must be taken when tightening the cap nuts that the torques are not exceeded in order to avoid cable damage.