
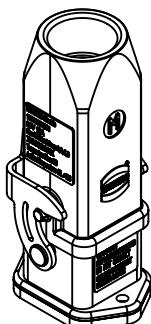
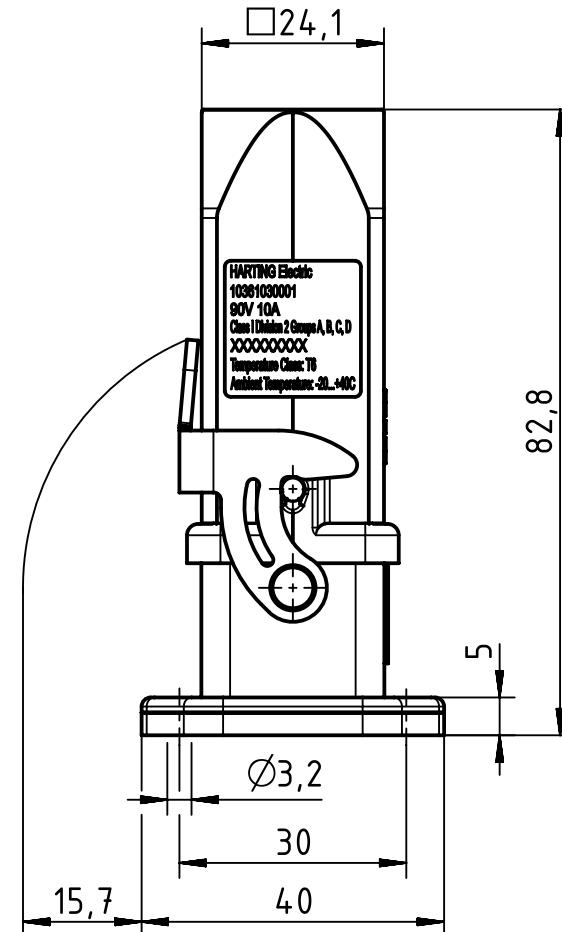
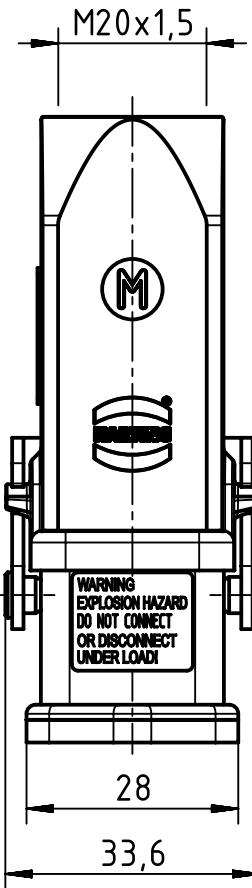


1 2 3 4 5 6

panel cut out

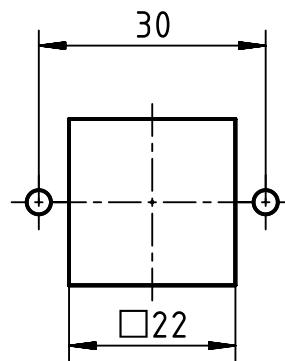


 All rights reserved Department EL PD - DE	All Dimensions in mm Original Size DIN A4	Scale	Free size tol.		Ref.		
		1:1			Sub.		
HARTING		Created by	RULLKOETTER	Inspected by	RIEPE	Standardisation	Date
						TIEMANNA	2016-12-08
Title						State Approved	
Han Ex UL 3A Set						Doc-Key / ECM-Nr.	
						100670815/UGD/002/B	
						500000112196	
Type	TB	Number 10 36 103 0001				Rev.	B
						Page	1/2

FOR USE WITH AWG: 14-20


FOR USE WITH CABLE TYPE:
PLTC, PLTC-ER, ITC, ITC-ER, MC, MV AND TC

FOR USE IN CLASS I, DIVISION 2 GROUPS A, B, C, AND D
HAZARDOUS LOCATIONS OR UNCLASSIFIED LOCATIONS

1.

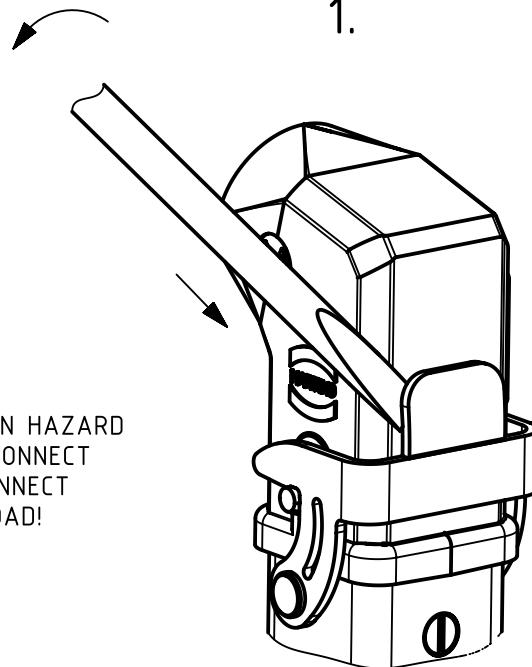

2.

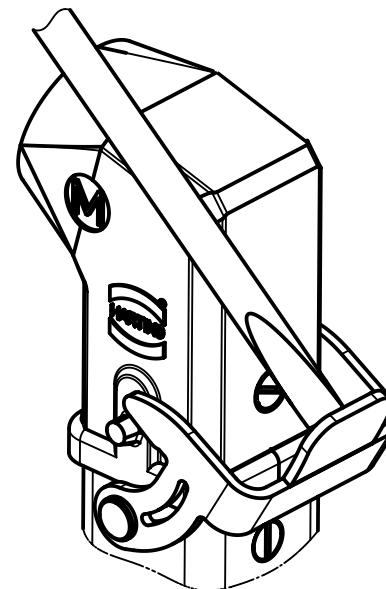

WARNING
EXPLOSION HAZARD
DO NOT CONNECT
OR DISCONNECT
UNDER LOAD!

THE INSTALLATION MUST BE IN
ACCORDANCE WITH THE
ASSOCIATED LOCATION
RESTRICTIONS OF THE NATIONAL
ELECTRIC CODE OR CANADIAN
ELECTRICAL CODE AS
APPLICABLE, INCLUDING ISSUES
SUCH AS THE ROUTING,
SUPPORT AND LENGTH OF THE
INVOLVED CORD OR CABLE.

To separate connectors, insert small flathead tool or screwdriver between metal lever and housing as shown in the diagram. Press screwdriver in a downward direction until the metal lever releases.

To secure the hood and housing assembly together, press the metal levers in the upward direction until metal lever latches into housing pins.